


# Dry Dock Water Flows



# Process Water

Including: Condensate,  
Infiltration, Hydro-blast,  
Equipment cooling etc.

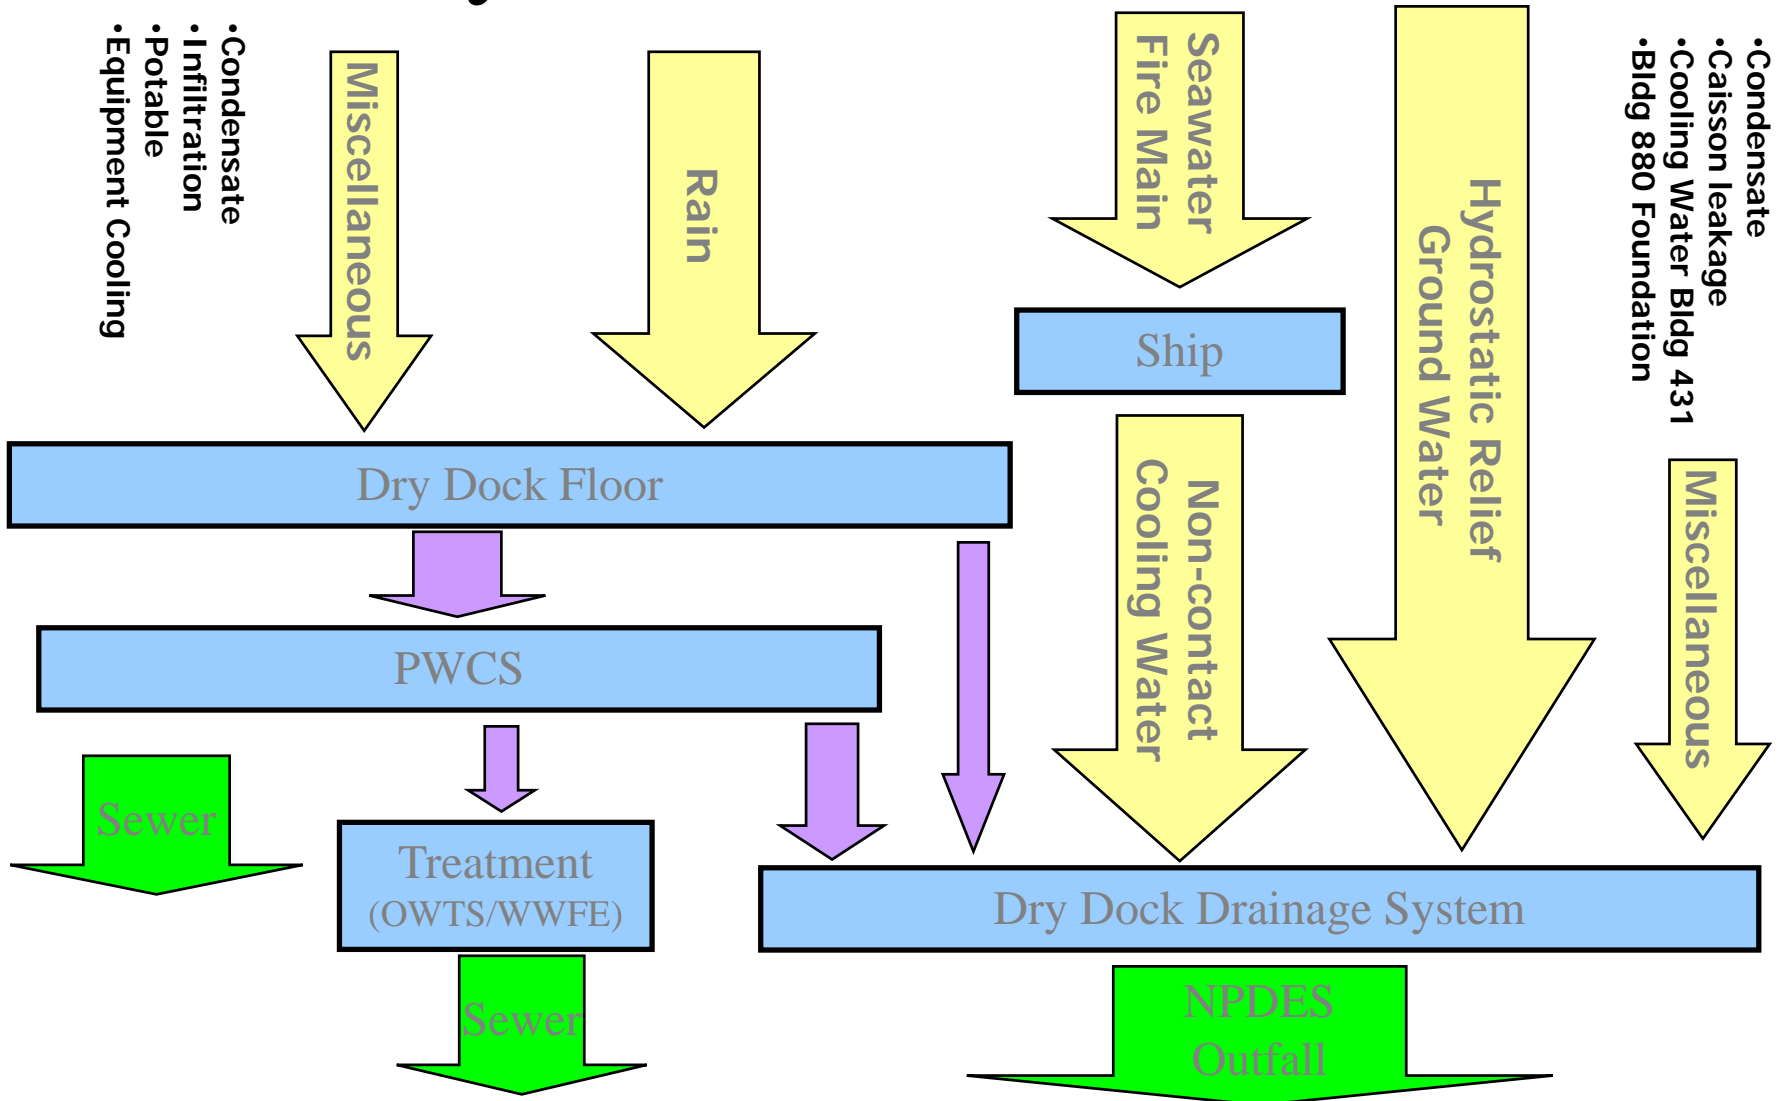


**Dry Dock Floor**



Dry dock turbidity Sensor

Clean water  
Under (25 NTU)



NPDES Outfall

To Inlet




Contaminated water  
(Over 100 NTU)



Holding tank or Treatment System

Dirty water  
From 25 to 100 NTU

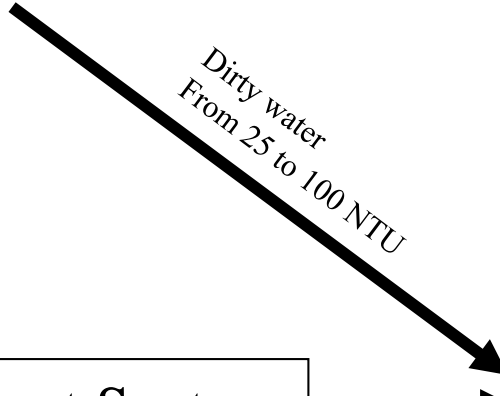

Sanitary Sewer



To POTW



# Non-Process Water

Including:  
Hydrostatic Relief  
Seawater Fire Main  
Non-contact Cooling

